

SAMPLE AND BUILDING INSPECTION REPORT

Client: Rock Island, Installation-wide Asbestos Survey, Phase VI, Quadrants 1, 2, 3, and 4

Location: 93
 Building Use/Description: Ltc./Mj housing
 AVG. # People/Hr: 2
 AVG. # Hrs/Day: 14
 AVG. # Days/Year: 340
 AVG. # Person Hrs/Year: 9520

Date: 1/14/1997
 Inspectors: S. Lynn, W. Kosco

Type of Material	Suspect ACBM	Sample No.	*Quantity	Condition	Friable	Physical	Air	Vibration	Water	Hazard Rank
12" grey with white specks FT	Yes	180RIA 93.2.1.1-A - ND	34 sf	Good	No	Moderate	Low	Low	Low	2
12" white with gold specks FT	Yes	144RIA 93.1.1.1 - 2% CH	0 sf	Good	No	Moderate	Low	Low	Low	2
12" white with gold specks FT	Yes	177RIA 93.3.1.1 - 2% CH	90 sf	Good	No	Moderate	Low	Low	Low	2
4" light brown CBM	Yes	193RIA 93.2.1.1 - ND		Good	No	Low	Low	Low	Low	1
4" square tan and grey with flowers linoleum	Yes	182RIA 93.4.1.1 - ND		Good	No	Moderate	Low	Low	Low	2
4" square tan and grey with flowers linoleum	Yes	183RIA 93.4.2.2 - ND		Good	No	Moderate	Low	Low	Low	2
4" tan CBM	Yes	175RIA 93.1.1.1 - ND	50 lf	Good	No	Low	Low	Low	Low	1
Antique white with purple flowers linoleum	Yes	184RIA 93.5.2.1 - ND	20 sf	Good	No	Moderate	Low	Low	Low	2
Black vibration dampener on furnace	Yes	181RIA 93.3.1.1 - ND	4 lf	Good	No	Low	Low	High	Low	1
Drywall	Yes	146RIA 93.3.1.1 - ND		Good	No	Low	Low	Low	Low	1
Drywall	Yes	178RIA 93.4.1.1 - ND		Good	No	Low	Low	Low	Low	1
Grey /tan square linoleum	Yes	147RIA 93.4.1.1 - ND	160 sf	Good	No	Moderate	Low	Low	Low	2

Notes:

ACBM = Asbestos-containing building material psi = Pounds per square inch
 CH = Chrysotile TSI = Thermal system insulation
 AM = Amosite FT = Floor tile
 CR = Crocidolite CT = Ceiling tile
 DCW = Domestic cold water CBM = Cove base molding
 DHW = Domestic hot water lf = Linear feet
 ND = Not detected sf = Square feet
 Dup = Duplicate NA = No sample collected

*Quantities listed are totals per homogeneous area, unless otherwise indicated in the description of the material.

SAMPLE AND BUILDING INSPECTION REPORT

Client: Rock Island, Installation-wide Asbestos Survey, Phase VI, Quadrants 1, 2, 3, and 4

Location: 93
 Building Use/Description: Ltc./Mj housing
 AVG. # People/Hr: 2
 AVG. # Hrs/Day: 14
 AVG. # Days/Year: 340
 AVG. # Person Hrs/Year: 9520


Date: 1/14/1997
 Inspectors: S. Lynn, W. Kosco

Type of Material	Suspect ACBM	Sample No.	*Quantity	Condition	Friable	Physical	Air	Vibration	Water	Hazard Rank
Mastic	Yes	180RIA 93.2.1.1 - 2% CH	34 sf	Good	No	Moderate	Low	Low	Low	2
White stone print linoleum	Yes	145RIA 93.2.1.1 - 20% CH	70 sf	Good	No	Moderate	Low	Low	Low	2
White stone print linoleum	No	179BRIA 93.5.1.1 -	44 sf		No					
White stone print linoleum	No	194RIA 93.3.1.1 - 33% CH	44 sf	Good	No	Moderate	Low	Low	Low	2
White/tan square linoleum	Yes	176RIA 93.2.1.1 - ND	160 sf	Good	No	Moderate	Low	Low	Low	2
Yellow/tan square linoleum	Yes	192RIA 93.1.1.1 - ND	160 sf	Good	No	Moderate	Low	Low	Low	2

Notes:



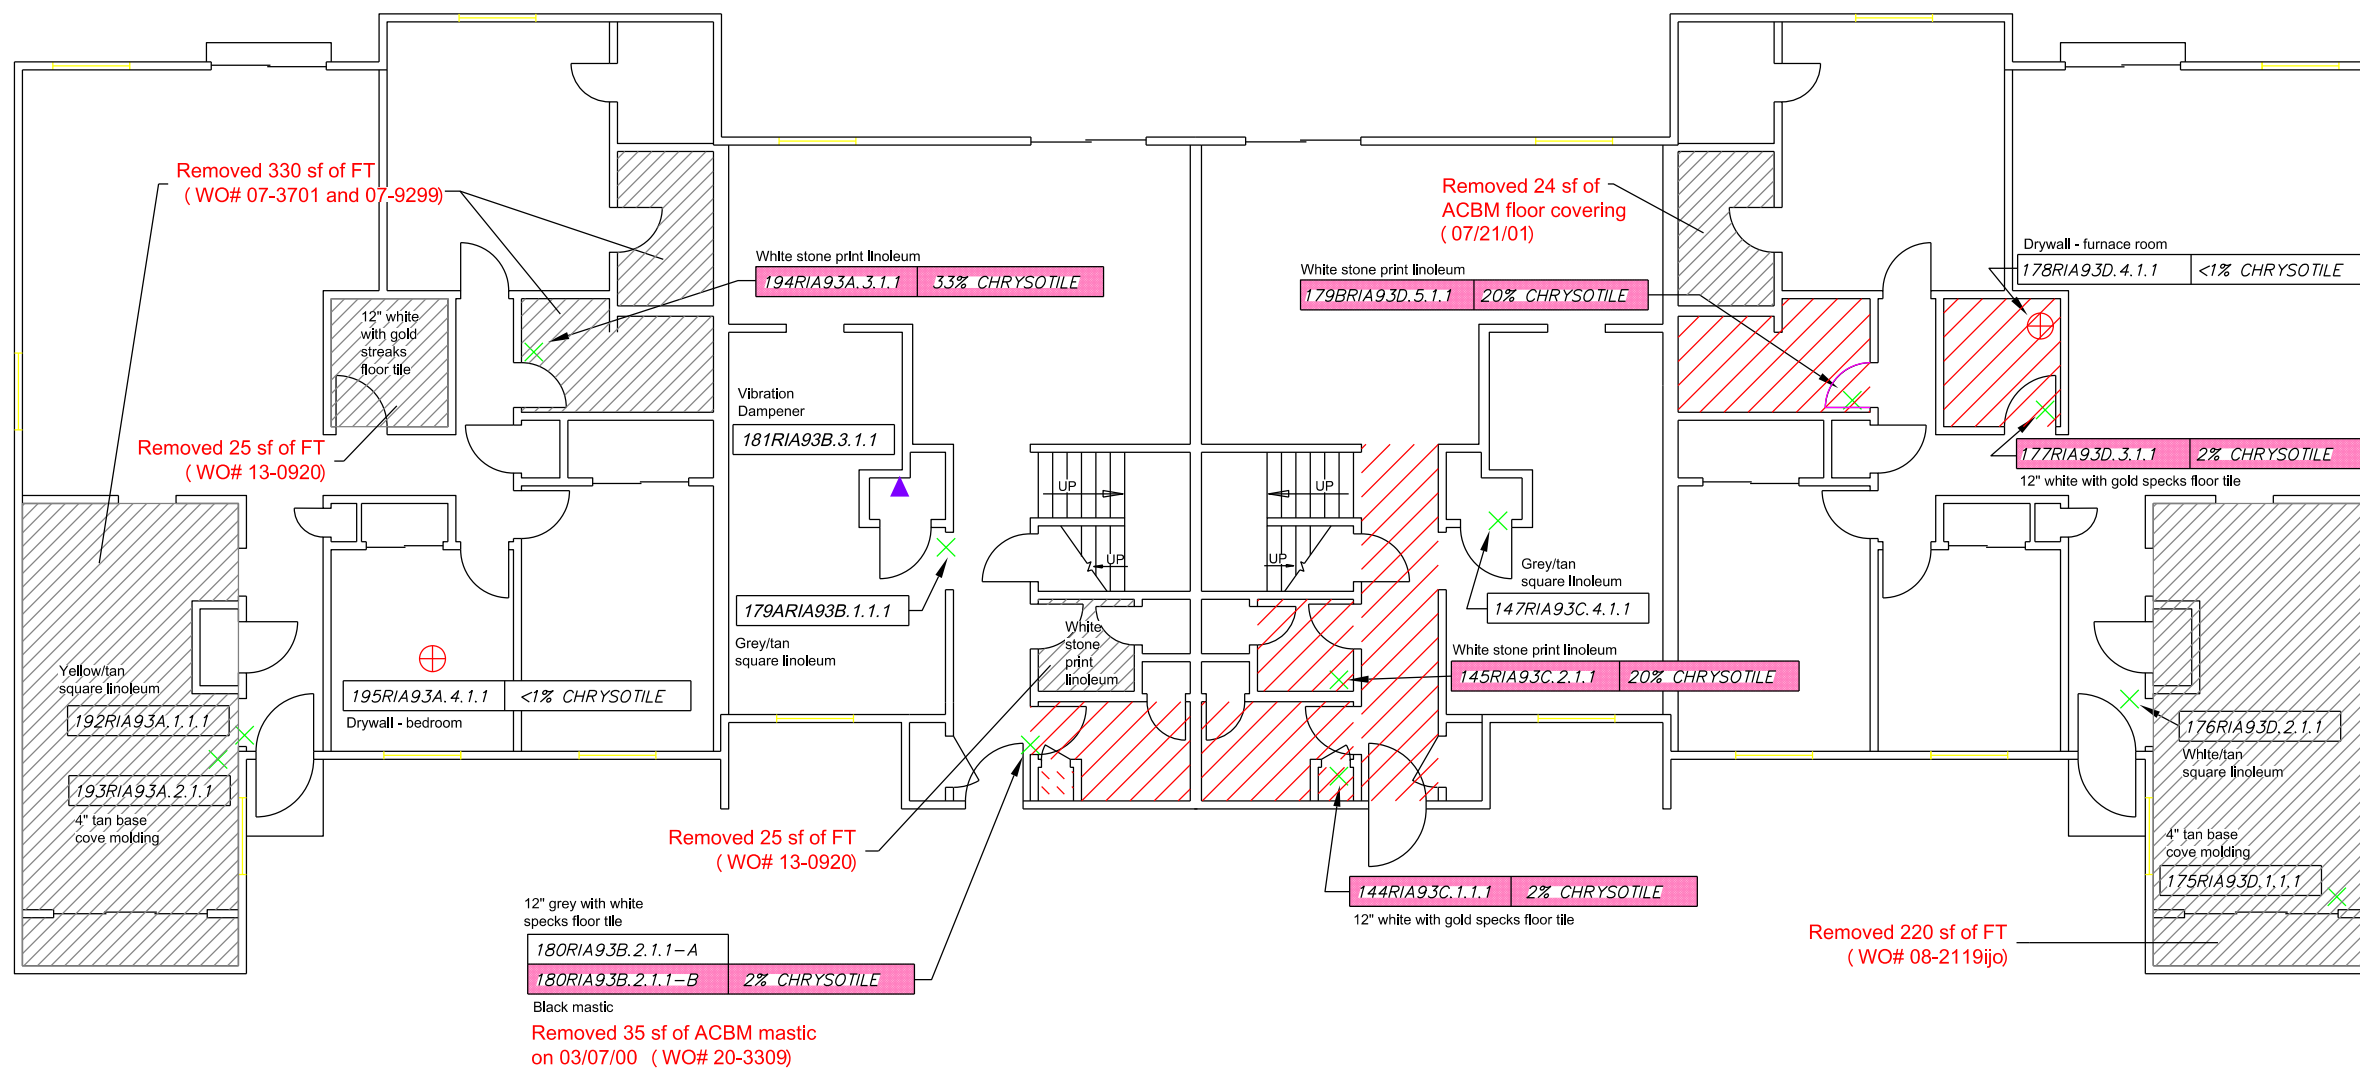



ACBM = Asbestos-containing building material psi = Pounds per square inch
 CH = Chrysotile TSI = Thermal system insulation
 AM = Amosite FT = Floor tile
 CR = Crocidolite CT = Ceiling tile
 DCW = Domestic cold water CBM = Cove base molding
 DHW = Domestic hot water lf = Linear feet
 ND = Not detected sf = Square feet
 Dup = Duplicate NA = No sample collected


*Quantities listed are totals per homogeneous area, unless otherwise indicated in the description of the material.



ABBREVIATIONS
 FG = FIBERGLASS
 MAG = MAGNESIUM
 TSI = THERMAL SYSTEM INSULATION
 FT = FLOOR TILE
 sf = SQUARE FEET
 lf = LINEAR FEET

LEGEND

-  WALL SAMPLE
 -  FLOOR SAMPLE
 -  CEILING SAMPLE
 -  ASBESTOS CONTAINING BUILDING MATERIAL
 -  ABATED ASBESTOS CONTAINING BUILDING MATERIAL
 -  ASSUMED ASBESTOS CONTAINING BUILDING MATERIAL AREA
- (NOTE: Assumption based on positive samples of similar building materials taken at corresponding locations in other building)


-  118RIA81.4.B.1 35% CHRYSOTILE
- ALL SHADED BOXES INDICATE ASBESTOS CONTAINING MATERIAL
- % AND TYPE OF ASBESTOS FOUND (NO PERCENTAGE NUMBER INDICATES ASBESTOS NOT DETECTED)
 - SAMPLE NUMBER WITHIN SPECIFIC HOMOGENEOUS AREA
 - FLOOR OF BUILDING
 - NUMBER OF HOMOGENEOUS AREA
 - BUILDING NUMBER
 - SAMPLE IDENTIFICATION NUMBER






REVISION DATE: SEPTEMBER 2014

ROCK ISLAND ARSENAL
 INSTALLATION-WIDE ASBESTOS SURVEY
 PHASE II - QUADRANT 1
 ROCK ISLAND, ILLINOIS

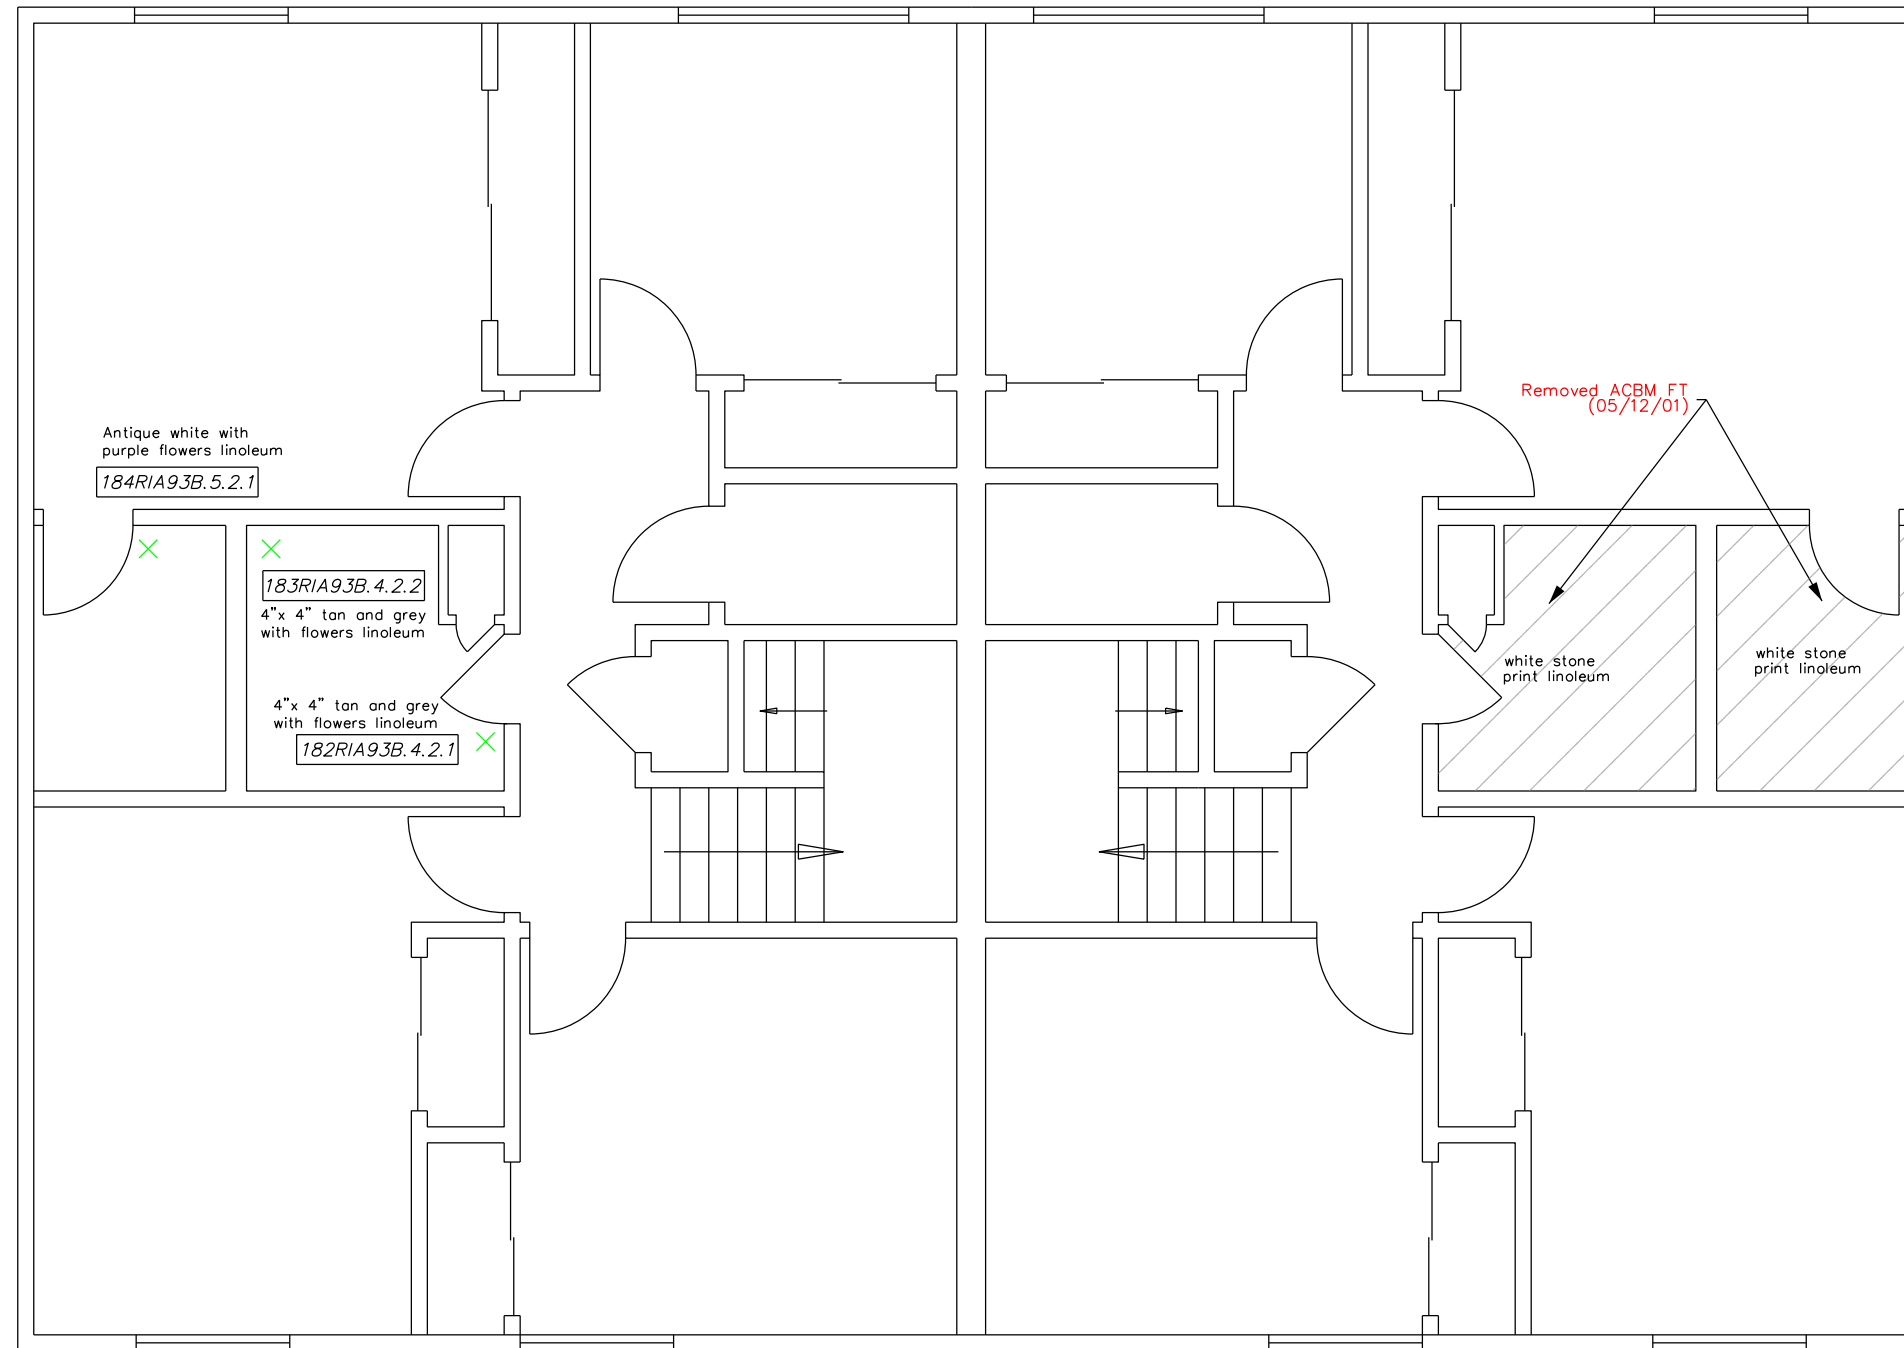FIGURE 93-F1
 BUILDING 093 - FIRST FLOOR
 SAMPLE LOCATIONS AND ASBESTOS
 CONTAINING HOMOGENOUS AREAS



LEGEND

-  WALL SAMPLE
-  FLOOR SAMPLE
-  CEILING SAMPLE

118RIA81.4.B.1 35% CHRYSOTILE

% AND TYPE OF ASBESTOS FOUND
(NO PERCENTAGE NUMBER INDICATES
ASBESTOS NOT DETECTED)

SAMPLE NUMBER WITHIN
SPECIFIC HOMOGENEOUS AREA

FLOOR OF BUILDING

NUMBER OF HOMOGENEOUS AREA


BUILDING NUMBER

SAMPLE IDENTIFICATION NUMBER

 ABATED ACBM

ABBREVIATIONS

- FG = FIBERGLASS
- MAG = MAGNESIUM
- TSI = THERMAL SYSTEM INSULATION
- FT = FLOOR TILE
- sf = SQUARE FEET
- lf = LINEAR FEET



REVISION DATE: SEPTEMBER 2014

ROCK ISLAND ARSENAL
INSTALLATION-WIDE ASBESTOS SURVEY
PHASE II - QUADRANT 1
ROCK ISLAND, ILLINOIS

FIGURE 93-F2
BUILDING 093 - SECOND FLOOR
SAMPLE LOCATIONS AND ASBESTOS
CONTAINING HOMOGENOUS AREAS

